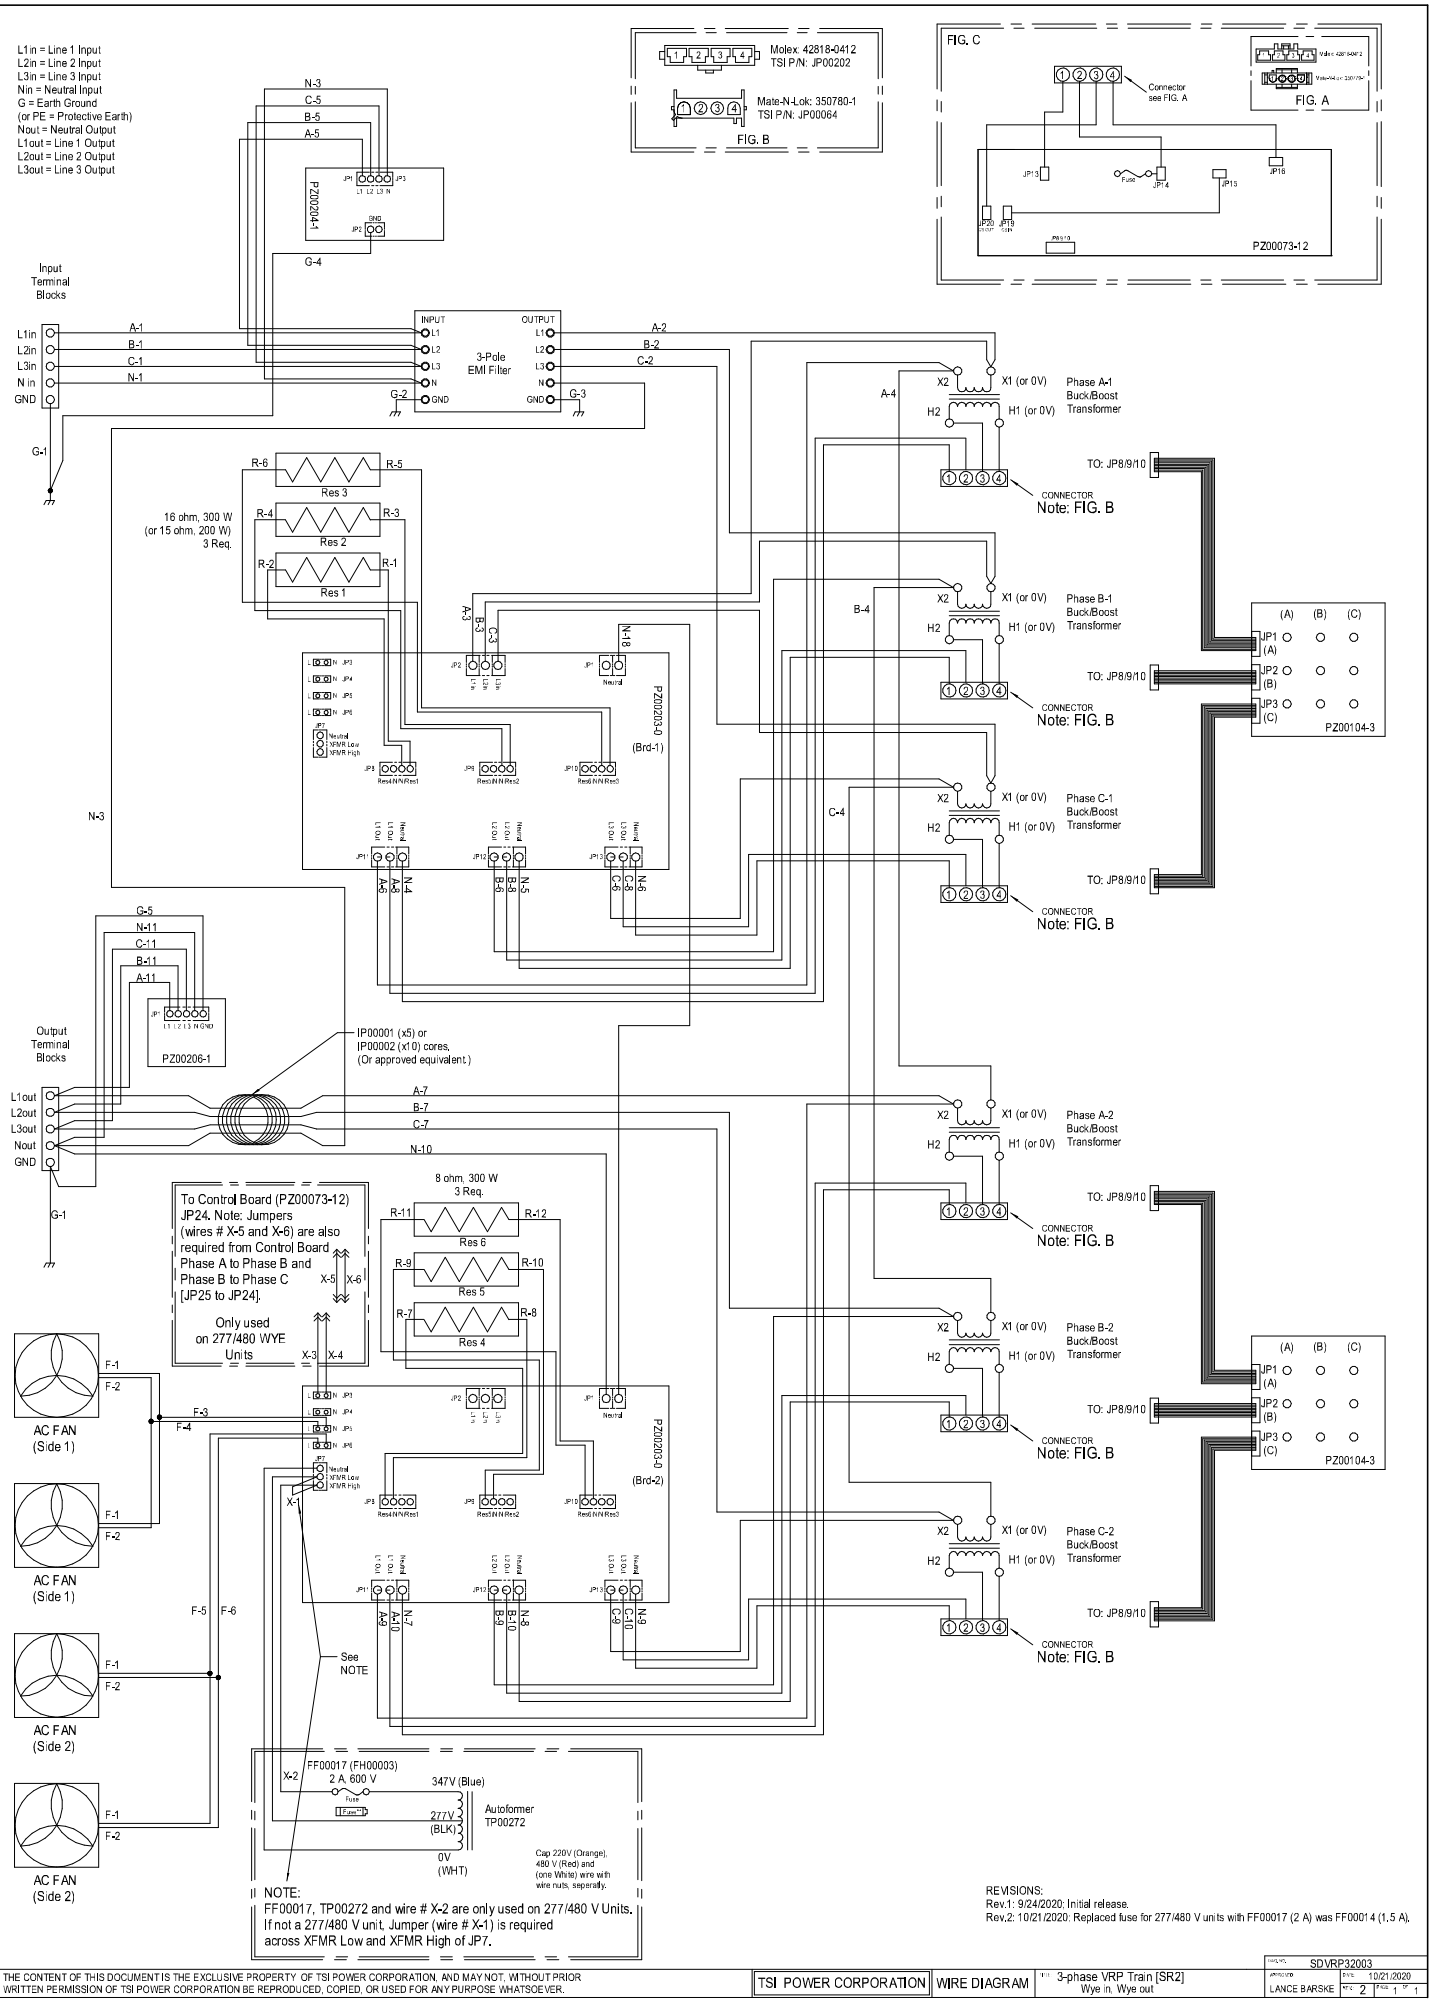

REVISIONS:
Rev.1: 9/24/2020: Initial release.
Rev.2: 10/21/2020: Replaced fuse for 277/480 V units with FF00017 (2 A) was FF00014 (1.5 A).

THE CONTENT OF THIS DOCUMENT IS THE EXCLUSIVE PROPERTY OF TSI POWER CORPORATION, AND MAY NOT, WITHOUT PRIOR WRITTEN PERMISSION OF TSI POWER CORPORATION BE REPRODUCED, COPIED, OR USED FOR ANY PURPOSE WHATSOEVER.

TSI POWER CORPORATION	WIRE DIAGRAM	TITLE: 3-phase VRP Train [SR2] Wye in, Wye out	DWG NO.: SDVRP32003
		APPROVED: LANCE BARSKE	DATE: 10/21/2020
			SHEET 2 OF 4